


Code of practice for the storage of flammable liquids

**CORRIGENDUM NO. 1**

September 2024

1. **Page 18, Figure 2 Separation distances between minor storage areas**

Replace Figure 2 with the diagram below:

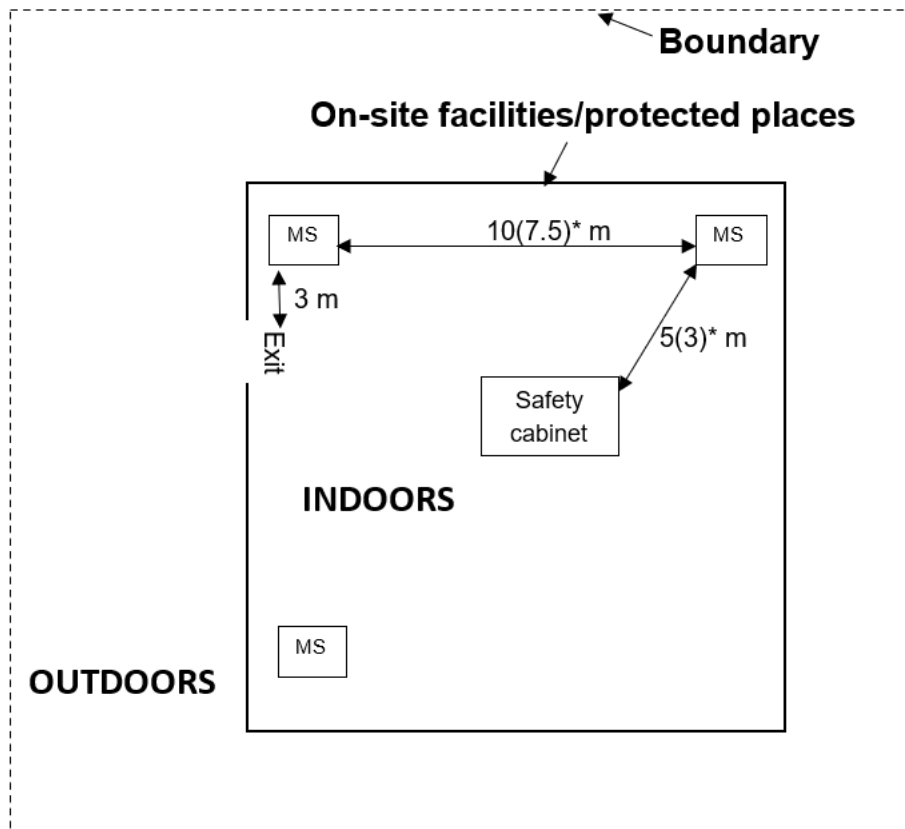

NOTE – MS refers to minor storage  
\*(separation distance for sprinkler-protected building)

2. **Page 78, 10.8.3.1 (c) (i)**

Replace “thank” with “tank”.